


IF IN DOUBT ASK


DO NOT SCALE

© COPYRIGHT RESERVED ET ENVIRONMENTAL LTD.

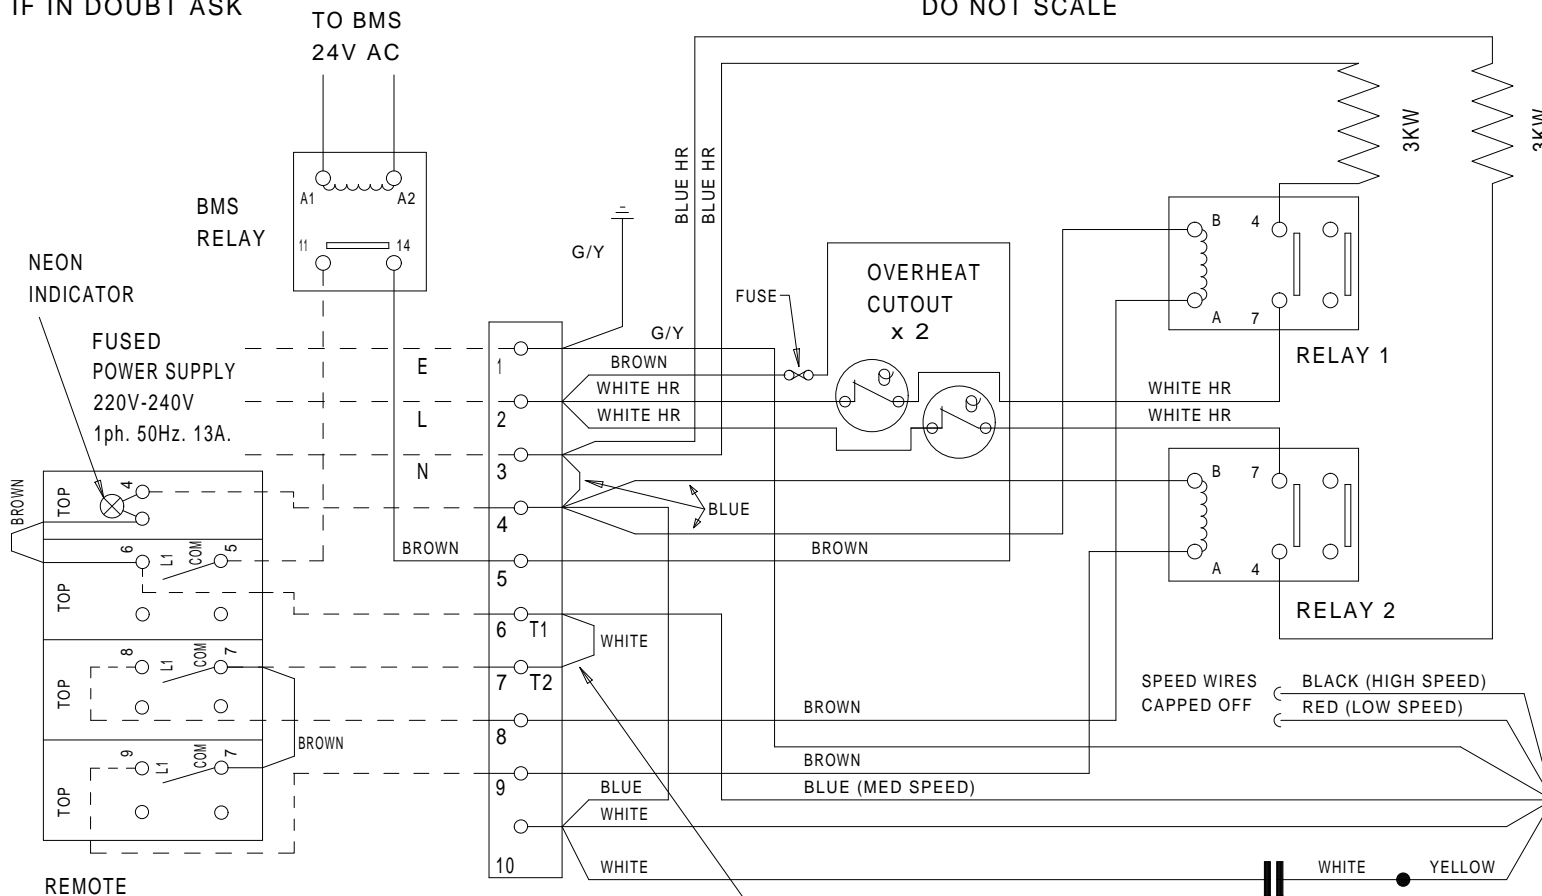


- NOTES:**
1. FIELD WIRING SHOWN THUS: - - - - -
 2. G/Y - GREEN/YELLOW
 3. INTERNAL WIRES TO BS.4808 COPPER 24/0,2(0,75mm²)
 4. HR - HEAT RESISTANT WIRE COPPER 1.3mm² WITH LAQ. GLASS BRAID OVERALL.
 5. HD - HEAVY DUTY TO BS6231 COPPER 1.5mm².

(LEADS TO BE LEFT LONG TO ADJUST SPEED ON SITE IF REQUIRED)



FAN MOTOR(S)

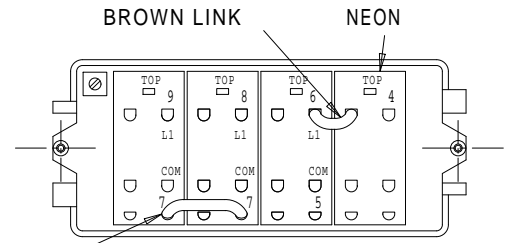

BROWN LINK REAR VIEW OF SWITCH ASSY. IN REMOTE CONTROL BOX

LOOP TO BE REMOVED WHEN USING REMOTE STAT.

NB. WIRING TO REMOTE CONTROL BOX BY OTHERS

REV.	MOD.NO.	DATE	DRN	CHKD	DRAWN	ANR	DIFFUSION ENVIRONMENTAL LTD 47 Central Avenue, West Molesey, Surrey, KT8 2QZ Telephone 020 8783-0033. Fax 020 8783-0140	
4	MIN MOD	23-07-12	DD	CDS	DATE	12-10-98		TITLE WIRING DIAGRAM. STOCK ROOM UNIT (SRE 6KW)
MODIFICATION							CHECKED CDS	JOB STANDARD
							DATE 12-10-98	
3	ECR 2288	21-11-00	JMK	CDS	APP'D	CDS	DRG.NO. A3/8600	
2	REQ 1533	12-10-98	ANR	CDS	DATE	12-10-98		